

Indoor Distribution Test Report

Spectrum Lighting Inc.

994 Jefferson Street
Fall River, MA 02721
+1.508.678.2303

Spectrum Lighting Photometric Lab

Luminaire

ME1314UDGV 37LGL 37LTF2 35KEX MWI
Indirect/direct Espresso

Test Number

SP-00255_57

Test Date

The results contained in this report pertain only to this IES file.

Summary of Results

Power

Input Watts	52 W
-------------	------

Lumen Output

Output Lumens	5550
Efficacy	106.74 lm/W

Luminous Dimensions

0° - 180° Size	-1.16
90° - 270° Size	-1.16
Height	0

Spacing Criterion

Two luminaires, plane 0°	1.37
Two luminaires, plane 90°	1.37
Four luminaires	1.33


Full Beam Angle

0° - 180°	267°
90° - 270°	267°

IES File Header Contents

Keyword	Value
TEST	SP-00255_57
TESTLAB	Spectrum Lighting Photometric Lab, VLS-245-981
MANUFAC	Spectrum Lighting
ISSUEDATE	5/6/2019
UPDATE	6/12/2019
LUMCAT	ME1314UDGV 37LGL 37LTF2 35KEX MWI
LUMINAIRE	Indirect/direct Espresso
LAMPCAT	N/A
LAMP	Indirect/direct source: 37L GV board / 37L GV board
OTHER	Uplight: 90 degree beam angle
OTHER	Uplight: Flush clear glass lens
OTHER	Downlight: 93.2 degree beam angle
OTHER	Downlight: Regressed 3 inch domed diffuser
OTHER	CCT Output Multipliers: 27K x 0.97, 30K x 0.98, 40K x 1.03, 50K x 1.06
OTHER	Total luminaire watts is approximate
OTHER	This report prepared by Spectrum Lighting

Candela Polar Plot

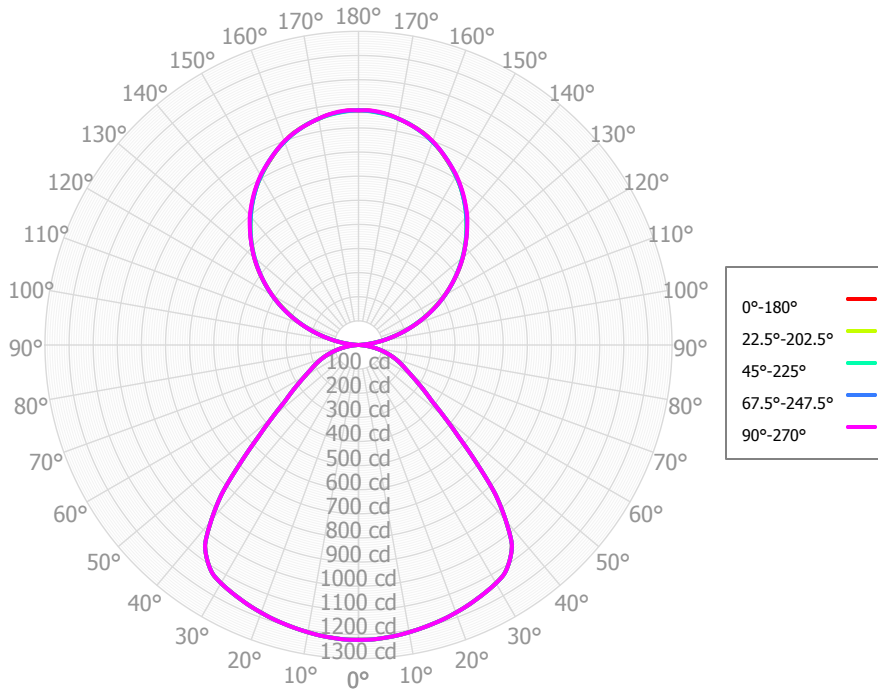

Zonal Lumen Summary

Zone	Lumens	% Fixture	Zone	Lumens	% Fixture
0.00° - 10.00°	121.87	2.19%	90.00° - 100.00°	36.36	0.65%
10.00° - 20.00°	338.49	6.09%	100.00° - 110.00°	180.12	3.24%
20.00° - 30.00°	536.88	9.66%	100.00° - 120.00°	509.04	9.16%
30.00° - 40.00°	673.74	12.12%	120.00° - 130.00°	437.62	7.87%
40.00° - 50.00°	536.30	9.65%	130.00° - 140.00°	486.66	8.76%
50.00° - 60.00°	305.89	5.50%	140.00° - 150.00°	472.40	8.50%
60.00° - 70.00°	201.03	3.62%	150.00° - 160.00°	394.29	7.09%
70.00° - 80.00°	118.29	2.13%	160.00° - 170.00°	262.04	4.72%
80.00° - 90.00°	30.12	0.54%	170.00° - 180.00°	96.48	1.74%
0.00° - 90.00°	2,862.61	51.51%	0.00° - 180.00°	5,557.51	100.00%

Candela Distribution

	0.00°	22.50°	45.00°	67.50°	90.00°
0.00°	1,222.55	1,222.55	1,222.55	1,222.55	1,222.55
2.50°	1,222.55	1,222.55	1,222.55	1,222.55	1,222.55
5.00°	1,219.15	1,219.15	1,219.15	1,219.15	1,219.15
7.50°	1,215.28	1,215.28	1,215.28	1,215.28	1,215.28
10.00°	1,209.35	1,209.35	1,209.35	1,209.35	1,209.35
12.50°	1,203.26	1,203.26	1,203.26	1,203.26	1,203.26
15.00°	1,196.44	1,196.44	1,196.44	1,196.44	1,196.44
17.50°	1,189.55	1,189.55	1,189.55	1,189.55	1,189.55
20.00°	1,180.92	1,180.92	1,180.92	1,180.92	1,180.92
22.50°	1,172.17	1,172.17	1,172.17	1,172.17	1,172.17
25.00°	1,162.00	1,162.00	1,162.00	1,162.00	1,162.00
27.50°	1,151.67	1,151.67	1,151.67	1,151.67	1,151.67
30.00°	1,140.30	1,140.30	1,140.30	1,140.30	1,140.30
32.50°	1,125.03	1,125.03	1,125.03	1,125.03	1,125.03
35.00°	1,092.25	1,092.25	1,092.25	1,092.25	1,092.25
37.50°	1,045.02	1,045.02	1,045.02	1,045.02	1,045.02
40.00°	950.48	950.48	950.48	950.48	950.48
42.50°	840.81	840.81	840.81	840.81	840.81
45.00°	693.10	693.10	693.10	693.10	693.10
47.50°	562.28	562.28	562.28	562.28	562.28
50.00°	465.21	465.21	465.21	465.21	465.21
52.50°	386.17	386.17	386.17	386.17	386.17
55.00°	335.91	335.91	335.91	335.91	335.91
57.50°	291.51	291.51	291.51	291.51	291.51
60.00°	254.68	254.68	254.68	254.68	254.68
62.50°	224.76	224.76	224.76	224.76	224.76
65.00°	201.93	201.93	201.93	201.93	201.93
67.50°	179.93	179.93	179.93	179.93	179.93
70.00°	158.40	158.40	158.40	158.40	158.40
72.50°	135.32	135.32	135.32	135.32	135.32
75.00°	112.20	112.20	112.20	112.20	112.20
77.50°	89.15	89.15	89.15	89.15	89.15
80.00°	66.26	66.26	66.26	66.26	66.26
82.50°	44.11	44.11	44.11	44.11	44.11
85.00°	23.62	23.62	23.62	23.62	23.62
87.50°	6.73	6.73	6.73	6.73	6.73
90.00°	6.55	6.55	6.55	6.55	6.55
92.50°	0.00	0.00	0.00	0.00	1.91
95.00°	28.52	26.52	23.09	26.14	24.27
97.50°	60.12	56.57	56.13	59.24	60.34
100.00°	94.79	93.12	91.64	95.15	95.06
102.50°	131.27	130.20	129.56	131.10	132.15
105.00°	170.49	169.15	170.03	171.01	170.99
107.50°	211.15	209.64	209.73	212.55	210.89
110.00°	252.61	250.41	248.81	252.56	252.10
112.50°	292.94	290.69	290.83	293.75	293.33

Coefficients of Utilization – Zonal Cavity Method

Values are lumens delivered to the workplane.

	pfc	20%	20%	20%	20%	20%	20%	20%	20%	20%	20%	20%	20%	20%	20%	20%	20%	0%
	pcc	80%	80%	80%	80%	70%	70%	70%	70%	50%	50%	50%	30%	30%	30%	10%	10%	0%
	pw	70%	50%	30%	10%	70%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	30%
RCR	0	5,974	5,974	5,974	5,974	5,522	5,522	5,522	5,522	4,678	4,678	4,678	3,905	3,905	3,905	3,196	3,196	2,863
	1	5,493	5,267	5,065	4,883	5,073	4,882	4,709	4,553	4,160	4,036	3,923	3,497	3,411	3,332	2,886	2,829	2,776
	2	5,036	4,649	4,329	4,060	4,648	4,317	4,041	3,806	3,695	3,491	3,316	3,121	2,976	2,848	2,590	2,491	2,402
	3	4,620	4,122	3,737	3,430	4,264	3,835	3,499	3,228	3,296	3,043	2,836	2,796	2,612	2,457	2,332	2,203	2,092
	4	4,247	3,675	3,256	2,937	3,920	3,426	3,057	2,773	2,955	2,674	2,452	2,518	2,309	2,140	2,111	1,961	1,836
	5	3,912	3,294	2,862	2,543	3,614	3,076	2,693	2,407	2,663	2,367	2,140	2,278	2,055	1,879	1,919	1,756	1,624
	6	3,614	2,968	2,534	2,222	3,341	2,776	2,389	2,109	2,412	2,109	1,884	2,072	1,840	1,663	1,754	1,582	1,447
	7	3,348	2,688	2,259	1,959	3,098	2,518	2,135	1,862	2,195	1,892	1,671	1,893	1,658	1,483	1,609	1,433	1,297
	8	3,111	2,446	2,028	1,740	2,881	2,295	1,919	1,657	2,007	1,707	1,493	1,737	1,502	1,330	1,483	1,304	1,193
	9	2,900	2,237	1,831	1,557	2,688	2,102	1,735	1,485	1,844	1,549	1,342	1,601	1,368	1,201	1,372	1,193	1,062
	10	2,711	2,055	1,663	1,402	2,516	1,934	1,578	1,339	1,701	1,413	1,214	1,482	1,252	1,090	1,274	1,097	968

Cone of Light

Mtg Height	Light Level	Beam Diameter
5.5 ft	40.4 fc	0.0 ft
6.5 ft	28.9 fc	0.0 ft
7.5 ft	21.7 fc	0.0 ft
8.0 ft	19.1 fc	0.0 ft
10.0 ft	12.2 fc	0.0 ft
12.0 ft	8.5 fc	0.0 ft
14.0 ft	6.2 fc	0.0 ft
16.0 ft	4.8 fc	0.0 ft
20.0 ft	3.1 fc	0.0 ft
24.0 ft	2.1 fc	0.0 ft
28.0 ft	1.6 fc	0.0 ft

Average Luminaire Luminance [cd/m²]

	0.00°	45.00°	90.00°
0.00°	12,452	12,452	12,452
45.00°	9,983	9,983	9,983
55.00°	5,965	5,965	5,965
65.00°	4,867	4,867	4,867
75.00°	4,415	4,415	4,415
85.00°	2,760	2,760	2,760

UGR CIE 190:2010

Ceiling reflectance		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall reflectance		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Plane reflectance		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
2H	2H	12.0	12.8	12.9	13.8	15.0	12.0	12.8	12.9	13.8	15.0
	3H	13.6	14.3	14.6	15.3	16.6	13.6	14.3	14.6	15.3	16.6
	4H	14.2	14.9	15.2	15.9	17.2	14.2	14.9	15.2	15.9	17.2
	6H	14.6	15.3	15.6	16.3	17.6	14.6	15.3	15.6	16.3	17.6
	8H	14.8	15.4	15.8	16.4	17.7	14.8	15.4	15.8	16.4	17.7
	12H	14.8	15.4	15.8	16.4	17.7	14.8	15.4	15.8	16.4	17.7
4H	2H	12.4	13.1	13.4	14.1	15.4	12.4	13.1	13.4	14.1	15.4
	3H	14.3	14.9	15.3	15.9	17.2	14.3	14.9	15.3	15.9	17.2
	4H	15.0	15.6	16.1	16.6	17.9	15.0	15.6	16.1	16.6	17.9
	6H	15.6	16.1	16.6	17.1	18.4	15.6	16.1	16.6	17.1	18.4
	8H	15.8	16.2	16.8	17.2	18.5	15.8	16.2	16.8	17.2	18.5
	12H	15.8	16.2	16.9	17.2	18.6	15.8	16.2	16.9	17.2	18.6
8H	4H	15.3	15.7	16.3	16.7	18.1	15.3	15.7	16.3	16.7	18.1
	6H	16.0	16.3	17.0	17.4	18.7	16.0	16.3	17.0	17.4	18.7
	8H	16.2	16.5	17.3	17.6	18.9	16.2	16.5	17.3	17.6	18.9
	12H	16.3	16.6	17.4	17.6	19.0	16.3	16.6	17.4	17.6	19.0
12H	4H	15.3	15.7	16.3	16.7	18.0	15.3	15.7	16.3	16.7	18.0
	6H	16.0	16.3	17.1	17.3	18.7	16.0	16.3	17.1	17.3	18.7
	8H	16.3	16.5	17.3	17.6	19.0	16.3	16.5	17.3	17.6	19.0

Corrected UGR values based on total output lumens

SHR = 1.0